SITE PLAN

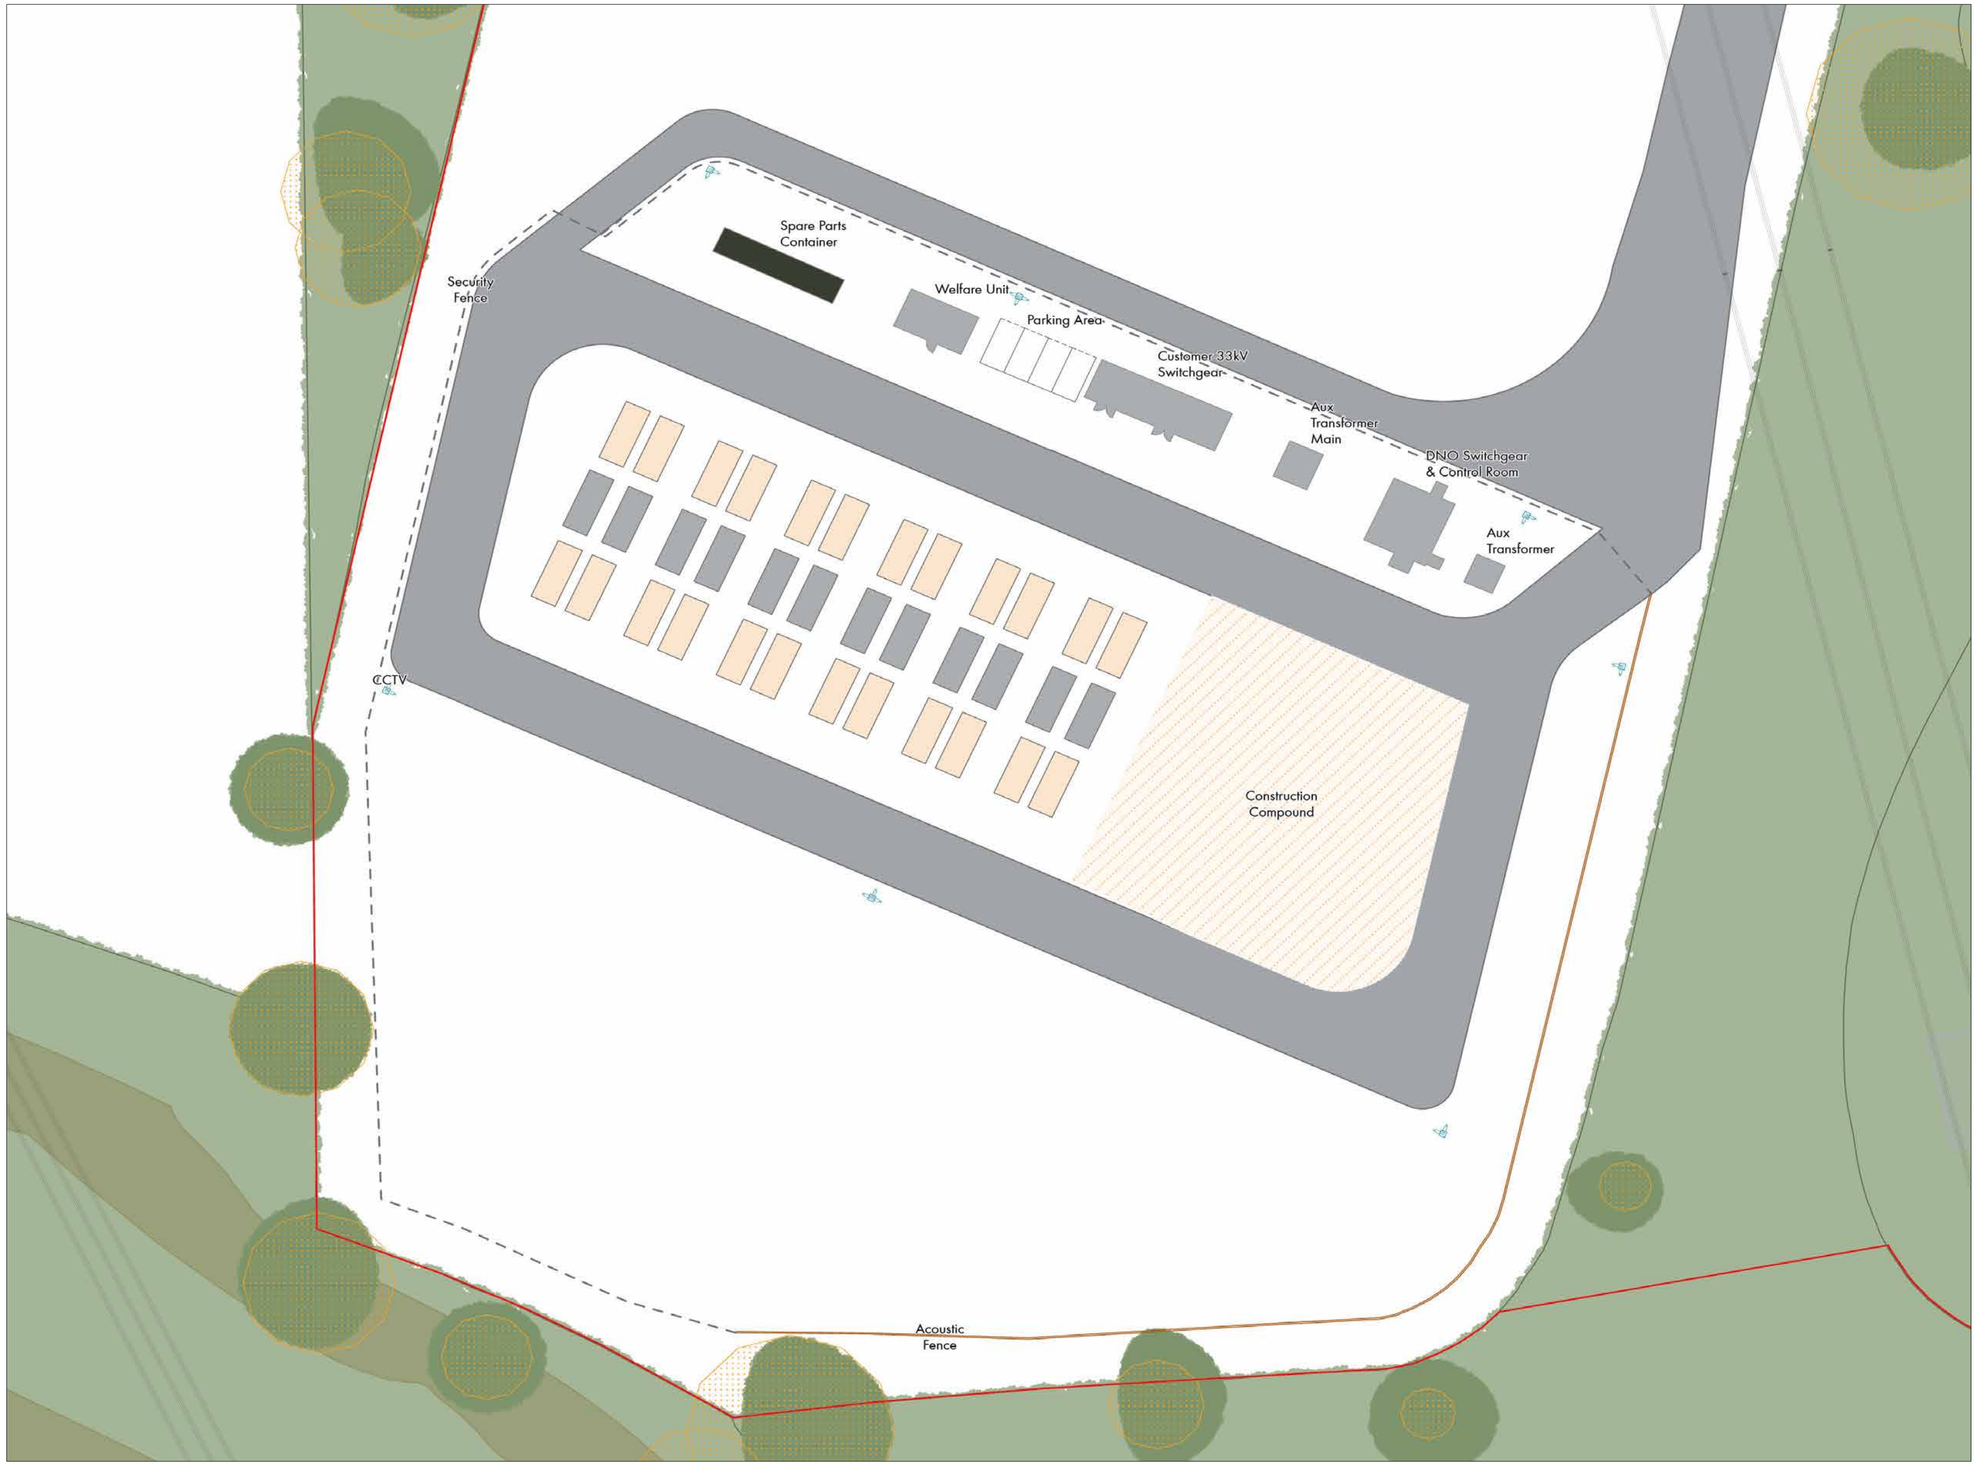

Development Area 12.29 ha

Battery Energy Storage System (BESS) unit

MV Station

Root Protection Area

DEVELOPMENT COMPONENTS

The proposed BESS development will likely comprise of the following components and layout, subject to change following further onsite assessments:

- 24x BESS Units
- 12x Battery Compacted Medium Voltage (MV) Station
- 2x auxiliary transformers
- Switchgear and control building
- Customer switchgear building
- Welfare building
- Spare parts container
- Security fencing
- 4x CCTV cameras
- Temporary site compound